

# Development and Performance Analysis of Multi Evaporative System

<sup>1</sup>Tejal T. Wani, <sup>2</sup>Amol A. Gawali, <sup>3</sup>Madhav S. Joshi

<sup>1,2</sup>Student, <sup>3</sup>Associate Professor

<sup>1</sup>Mechanical Department,

<sup>1</sup>Walchand College of Engineering, Sangli, India

**Abstract** - The focus of this research paper is on the development of a multi evaporator system (3 evaporators) to maintain the different operating temperature in evaporators with a single compressor, an individual expansion device and an air cooled condenser. The modeling methodology is developed with the multiple objectives of control and design. Firstly, the individual components of this model are developed based on the best published theoretical and empirical literature. This system is used to maintain -10°C, 0°C and +10°C in three compartment. An air conditioner compressor of 1.5 tons is used for the setup purpose. Refrigerant R-22 is used for system. Multi evaporator systems yields the higher value of coefficient of performance compared to single evaporator system meant for different temperatures. There is easy control of fluctuations in loads by controlling individual evaporator. Also saving in initial cost and space required are the additional advantages with single compressor multi evaporator systems.

**Index Terms** - Multi evaporator system, solenoid valve, evaporator design, variable load

## I. INTRODUCTION

There are many applications where refrigeration plant is required to meet the various refrigerating loads at different temperatures. For example, systems for hotels, large restaurant, institutions and food preservation industries. In these cases, it is necessary that each location is cooled by separate evaporators to maintain the particular temperature and produce the required refrigeration load. Hence it requires different refrigerating units with single evaporator for each location. Instead it will be beneficial to use a refrigerating unit with multiple evaporators working at different temperatures. Therefore, it is the purpose of this paper to introduce vapor compression system which uses a single compressor and individual expansion devices to provide the concurrent testing.

## II. DESIGN AND SELECTION OF COMPONENTS

### Compressor

The rated cooling capacity of compressor is 5.265 kW i.e., 1.5TR. These capacity is divide into three evaporator for experimental work in which lowest temperature evaporator (Evaporator-I) is designed for 0.08 TR capacity, middle temperature evaporator (Evaporator-II) is designed for 0.23 TR capacity and the high temperature evaporator (Evaporator-III) is design for 0.49 TR capacity. Compressor model CR-22-K6M-PF1 choose for this system which give rated condensing pressure up to 21 bar and evaporative pressure 5.02 bar. During selection of compressor, speed, volumetric efficiency, refrigerant, condensing and Evaporative temperature is considered.

Table 2 Specifications of compressor

No.	Parameter	Unit	Value
1	Capacity	TR	1.528
2	Evaporating Temperature	<sup>0</sup> c	7.2
3	Condensing Temperature	<sup>0</sup> c	55
4	Suction Pressure	bar	5.02
5	Discharge Pressure	bar	21

### Condenser

Condenser is the nothing but the heat transfer surface which rejects the heat at constant pressure so it is selected by calculating condenser load. It is simply calculated by formula.

$$\text{Condenser load} = \text{Compressor capacity} \times \text{heat rejection factor (1)}$$

An air cooled fin type condenser having surface area 55 cm × 42.5, 4 rows and 17 passes is selected which is capable to reject heat absorbed in evaporators and the energy equivalent of the work of compression in compressor. Heat rejection factor is obtained from condensing and evaporating temperature of system. The condenser capacity is determine using following formula [3]

$$Q = U_o \times A_o \times \Delta T \quad (W) \quad (2)$$

Where,

$U_o$  = Overall heat transfer coefficient based on outside area ( $W/m^2 \text{ } ^\circ C$ ),

$A_o$  = Outside area of tube ( $m^2$ ),

$\Delta T$  = L.M.T.D for condenser ( $^\circ C$ )

Thermostatic Expansion valve (TX2) having temperature range  $-40/+10^\circ C/-40/+50^\circ F$  is selected which give the require pressure drop for the evaporator.

### Evaporator Design

The rated cooling capacity of compressor is 5.265 kW i.e., 1.5TR. In order to have satisfactory performance of multiple temperature evaporator system, consider the actual cooling capacity given by compressor is 0.8 TR. For present work lowest temperature evaporator (Evaporator-I) is designed for 0.08 TR capacity. Evaporator I is used to store milk and dairy products. Evaporator II is used to store milk and dairy products. Evaporator III is used to store agriculture product like beans, potato, mango, oranges. While designing, Evaporator temperature and Condensing temperature is important which give the cooling capacity of the evaporator, the value of evaporator cooling capacity obtained from standard data sheet of compressor. Materials of evaporator, velocity of refrigerant, thickness of wall and contact surface area are some parameters which affect the cooling capacity of evaporator. Formula given below is used to design evaporators

$$Q = U_o A (T_2 - T_1) \quad (W) \quad (3)$$

Where,

$U_o$  = Overall heat transfer coefficient ( $W/m^2$ )

$A$  = Area of evaporator surface in ( $m^2$ ),

$T_2$  = outside the evaporator Temperature ( $^\circ C$ ),

$T_1$  = inside the evaporator Saturation temperature ( $^\circ C$ ).

Then mass flow of refrigerant is calculated by formula theoretically

$$Q = m_r \times (h_2 - h_1) \quad (W) \quad (4)$$

Where

$(h_2 - h_1)$  = Enthalpy difference between compressor inlet and outlet (kJ/kg)

$m_r$  = Mass flow of refrigerant (kg/sec)

### III. EXPERIMENTAL SETUP

An experimental setup consists of a single compressor three evaporator system to maintain  $-10^\circ C$ ,  $0^\circ C$  and  $+10^\circ C$  in three separate compartments with cooling load. The major components of the system are compressor, condenser, fan, receiver, filter-drier, expansion devices, back pressure valves, evaporators, and accumulator. A setup manufactured to experimentally investigate the performance of multi evaporator system with three evaporator and refrigerant R-22.

Table 1 Specifications of system

Sr. No	Parameters	Description
1	Type	Multi Evaporator system
2	Refrigerant	R-22
3	Capacity	1.5 TR
4	Compressor	Hermetically sealed, Reciprocating, two cylinders.
5	Condenser	Finned coils, Air cooled
6	Expansion device	Thermostatic expansion valve
7	Evaporators	Bare tube type finned- 3 Evaporators

Experimental setup consist of four major part of refrigeration system such as compressor, which compresses refrigerant, condenser which rejects the heat from refrigerant at constant pressure, an expansion device which drop down the temperature and pressure of the refrigerant and finally evaporator which is absorbs heat from refrigerated space. All the component of the refrigeration system is mounted on portable metallic panel. Measurement instruments such as pressure gauges and thermocouples are placed before and after each component for data collection in order to understand the fluid medium conditions during the heat transfer process.

### IV. RESULT AND DISCUSSION

An experiment is conducted with the change in load of the evaporators various heat inputs at the simulator to test the performance of the system to maintain the temperature of evaporators. The heat inputs are tuned down from 1500 W to 300 W in steps of 300 W and each test is given a time interval of 20 minutes to reach steady state conditions. Figure 1 shows the response of the power consumed by compressor at the various heat loads supplied. It is observed that increase in load increases the mass flow rate of refrigerant. Hence compressor requires more power for suction of refrigerant. Figure 2 shows the response of coefficient of performance at the various heat loads supplied. It is observed that as load increases power consumed by compressor also increases. But comparatively increase in power consumed is less than increase in load. Hence coefficient of performance of the system increases with increase in load.

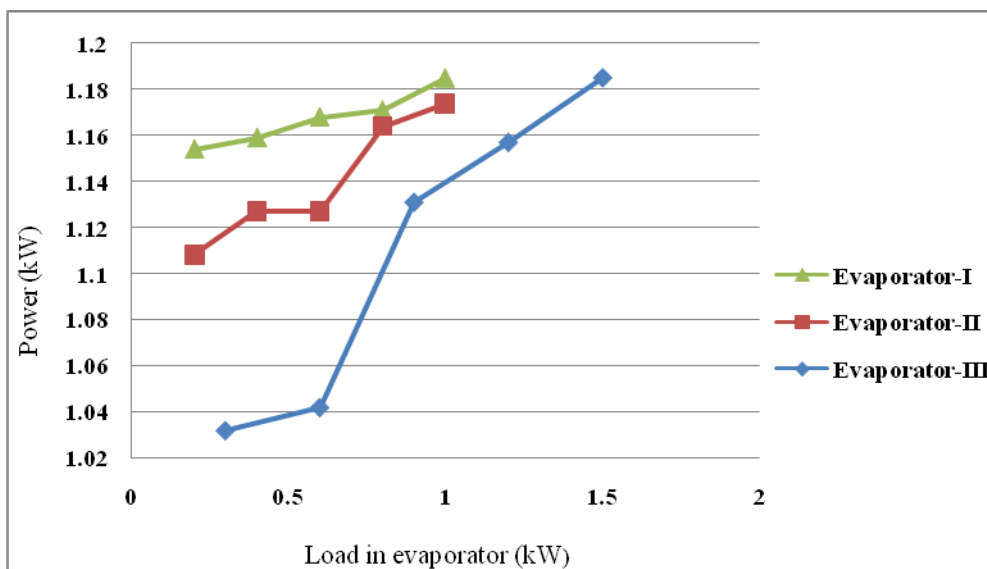


Figure 1 Graph for power of compressor v/s Load on evaporator

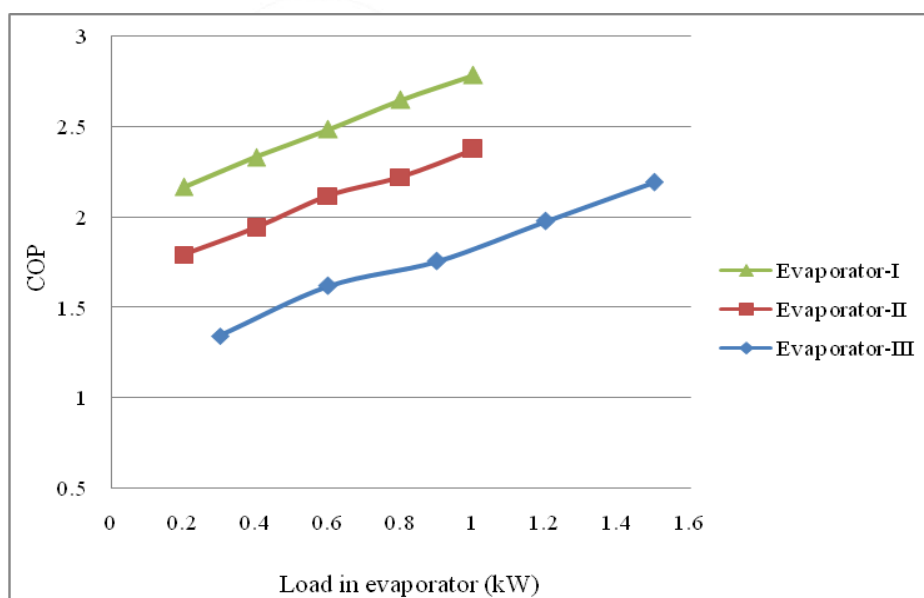


Figure 2 Graph for Coefficient of performance v/s Load on evaporator

## V. CONCLUSION

In this paper, multi-evaporator refrigeration system which features independent control of the cooling capacity at each evaporator is presented. The combined action of the thermostatic expansion valve and back pressure valve allows the cooling capacity at the evaporator to be controlled for testing of evaporator under various heat loads. The result of the test conducted by change in load on evaporators shows that with increase in load on any evaporator, power consumed by compressor increases. It is found that comparatively total load on evaporator is more than power consumed. Hence coefficient of performance increases with increase in load.

## VI. ACKNOWLEDGMENT

I with great pleasure take this opportunity to express my deep sense of gratitude towards Walchand College of Engineering, Sangli affiliated to Shivaji University, Kolhapur for allowing me to do the dissertation work on "Development and performance analysis of multi evaporator system" Engine, facilities like Refrigeration lab available in college. I would also like to thank Prof. Madhav S. Joshi, my dissertation guide, for his valuable guidance and constant inspiration during the completion of this paper. I express my special thanks to Prof. Dr. B. S. Gawali for their guidance whenever necessary. My sincere thanks to all my fellow student friends for their valuable suggestions & co-operation and constant appreciation and inspiration as well. Lastly, I would like to thank all those who helped me directly or indirectly.

## REFERENCES

- [1] Arora C. P., "Refrigeration and air conditioning", Tata McGraw Hill Private Limited, 3rd Edition, 2008.
- [2] Matthew S. Elliott and Bryan P. Rasmussen "Model-Based Predictive Control of a Multi-Evaporator Vapor Compression Cooling Cycle" American Control Conference in Washington, USA, June 11-13, 2008

- [3] Yunus A. Cengel,” Heat & mass transfer: A Practical Approach”, The Mc-Graw Hil Companies, 3rd Edition, 2007
- [4] Yuwen You, Aiguo Wu, Shu Yang “An optimal control strategy for Multi-Evaporator Vapor Compression Systems” ,International Conference on Electrical and Control Engineering, May 2010
- [5] V. Jaishree “Optimization of a multiple Effect Evaporator System” A Thesis submitted to the National Institute of Technology, Rourkela, June 2010.
- [6] Dossat R. J., “Principles of refrigeration”, Pearson, 4th Edition, 2007
- [7] Bryan P. Rasmussen and Matthew S. Elliott “A Model-Based Predictive Supervisory Controller for Multi- Evaporator HVAC Systems” American Control Conference Hyatt Regency Riverfront, St. Louis, USA June 10-12, 2009
- [8] W. H. Lee, M. S. Kim” Experimental Study on the Performance of Dual-Evaporator Refrigeration System with an Ejector” International Refrigeration and Air Conditioning Conference, Paper 503,2000.

